



Duct Temperature Sensors

QAM2161.040
QAM3163.040
QAM2171.040
QAM3173.040

- Active sensors for acquiring the air temperature in air ducts
- Operating voltage AC 24 V or DC 13.5...35 V
- Signal output DC 0...5 V, DC 0...10 V or 4...20 mA

Use

The QAM... duct temperature sensors are for use in ventilation and air conditioning plants as:

- Supply or extract air temperature sensors
- Limit sensors, e.g. for minimum limitation of the supply air temperature
- Reference sensors, e.g. for compensation of the room temperature as a function of the outside temperature
- Measuring sensors, e.g. for measured value indication or for connection to a building automation and control system

Type summary

Type reference	Probe length	Measuring range	Measuring accuracy	Operating voltage	Output signal	IP
QAM2161.040	0.4 m	-50...+50 °C	-25...+25 °C: ± 0.75 K -50...50 °C: ± 0.9 K	AC 24 V ± 20 % / DC 13.5...35 V	DC 0...5 V / DC 0...10 V 4...20 mA	IP54
QAM3163.040	0.4 m	-50...+50 °C	23 °C: ± 0.2 K -25...25 °C: ± 0.75 K -50...50 °C: ± 0.9 K	AC 24 V ± 20 % / DC 13.5...35 V	DC 0...10 V	IP65
QAM2171.040	0.4 m	-50...+50 °C	-25...+25 °C: ± 0.75 K -50...50 °C: ± 0.9 K	DC 13.5...35 V	4...20 mA	IP54
QAM3173.040	0.4 m	-50...+50 °C	23 °C: ± 0.2 K -25...+25 °C: ± 0.75 K -50...50 °C: ± 0.9 K	DC 13.5...35 V	4...20 mA	IP65

Ordering and delivery

When ordering, please give name and type reference, e.g.:

Duct temperature sensor **QAM2161.040**

The sensor is supplied complete with mounting flange AQM63.0 and cable entry gland M16.

Equipment combinations


All systems or devices capable of acquiring and handling the sensor's DC 0...5 V, DC 0...10 V or 4...20 mA output signal.

Function

The sensor acquires the air temperature via its sensing element whose resistance value changes as a function of the temperature. This change is converted to a DC 0...5 V, DC 0...10 V or 4...20 mA output signal, depending on the type of sensor. The output signal corresponds to the selected temperature range.

Burden diagram
(QAM2171.040)

Output signal, terminal I1

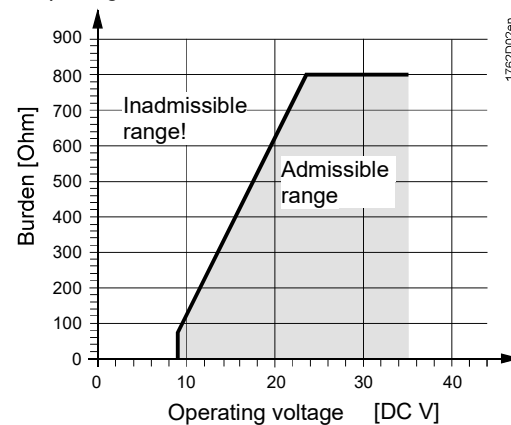

Mechanical design

The duct temperature sensor consists of housing, printed circuit board, connection terminals and probe.

The 2-sectional housing is comprised of base and removable cover (snap-on design). The measuring circuit and the setting element are located on the printed circuit board inside the cover, the connection terminals on the base.

Cable entry is made via the M16 cable entry gland (QAM2161.040, QAM2171.040: IP54; QAM3163.040, QAM3173.040: IP65) supplied with the sensor which can be screwed into the housing. Probe and housing are rigidly connected.


A rubber seal is installed between base and cover in order to satisfy the requirements of IP65 degree of protection. (QAM3163.040, QAM3173.040)

The sensor is designed for screwed or flanged mounting.


It can be fitted as follows:

- With the mounting flange supplied with the sensor (recommended), which is to be fitted to the sensor and then secured in accordance with the required immersion length, or
- Without mounting flange (making use of the maximum immersion length). For that propose, the housing has 4 holes for fitting the sensor directly to the air duct


Setting element
QAM2161.040

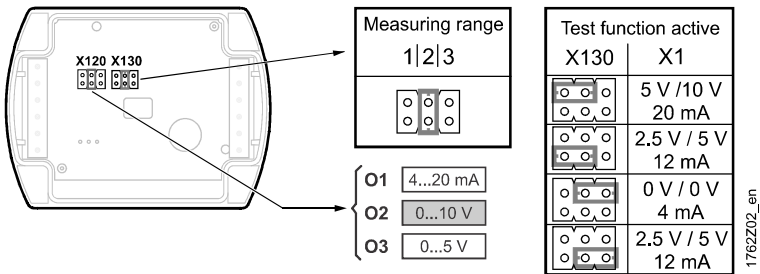

QAM3163.040

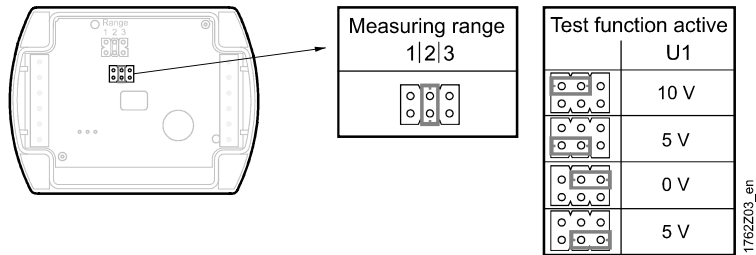

QAM2171.040,
QAM3173.040

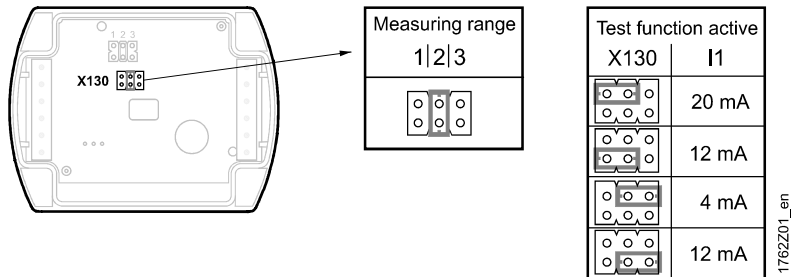

The setting element is located inside the cover. It consists of 6 pins and a shorting plug. It is used to select the required measuring range and to activate the test function.

The different plug positions have the following meaning

- **For the temperature measuring range:**
Shorting plug in the left position (R1) = 0...50 °C
Shorting plug in the mid position (R2) = -50...+50 °C (factory setting)
Shorting plug in the right position (R3) = -35...+35 °C
- **For activating the test function:**
Shorting plug in the horizontal position: The values according to the table "Test function active" will be made available at the signal output.

Fault
QAM2161.040

In the event of fault, the output signal will reach 0 V (0 mA).

QAM3163.040

In the event of fault, the output signal will reach 0 V.

QAM2171.040,
QAM3173.040

In the event of fault, the output signal will reach 4 mA.

Engineering notes

Cable routing and cable selection

To power the sensor, a transformer for safety extra low-voltage (SELV) with separate windings for 100 % duty is required. When sizing and electrically protecting the transformer, local safety regulations must be observed.

When sizing the transformer, the power consumption of the temperature sensor must be taken into consideration. For correct wiring, refer to the Data Sheets of the devices with which the sensor is used.

The permissible cable lengths must be observed.

When laying the cables, it must be observed that the longer the cables run side by side and the smaller the distance between them, the greater the electrical interference. Twisted pair cables are required for the secondary supply lines and the signal lines.

Mounting notes

Mounting location

- *For supply air temperature control:* Downstream from the fan, if the fan is located after the last air handling unit. Otherwise, after the last air handling unit with a minimum distance of 0.5 m
- *For extract air temperature control:* Always upstream of the extract air fan
- *As a limit sensor for the supply air temperature:* As close as possible to the air outlet into the room
- *For dew point control:* Immediately after the spray trap of the air washer


Manually bend the probe so that it lies diagonally across the duct or in equally spaced windings across the entire duct cross-section. The probe must not touch the duct wall. Mounting Instructions are printed on the packaging.

QAM3163.040,
QAM3173.040

NOTICE

!

Make sure the cover housing is installed on the corresponding base (same printed number locates at ① ②) during mounting. Otherwise, accuracy may be affected.

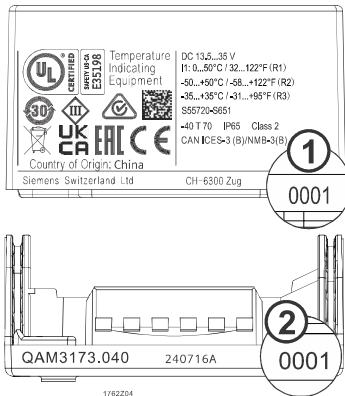

Mounting positions


Permitted:



Not permitted:



Mounting examples

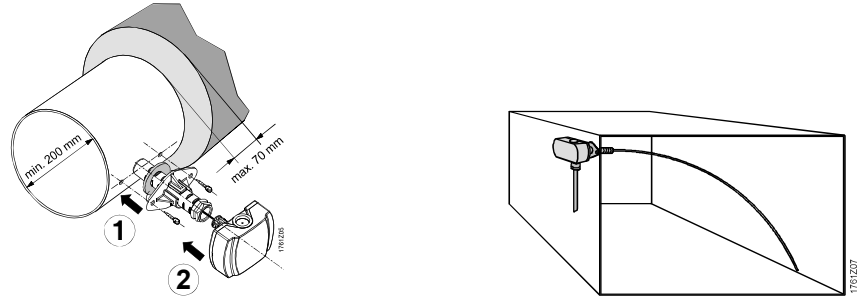

Disposal



This symbol or any other national label indicate that the product, its packaging, and, where applicable, any batteries may not be disposed of as domestic waste. Delete all personal data and dispose of the item(s) at separate collection and recycling facilities in accordance with local and national legislation.

For additional details, refer to www.siemens.com/bt/disposal.

Technical data


Power supply	Power supply	Safety extra-low voltage (SELV)	
	Operating voltage (QAM2161.040, QAM3163.040)	AC 24 V $\pm 20\%$, or DC 13.5...35 V	
		or	
	Operating voltage (QAM2171.040, QAM3173.040)	AC/DC 24 V class 2 (US)	
		DC 13.5...35 V	
		or	
		DC 24 V class 2 (US)	
	Frequency	50/60 Hz at AC 24 V	
	External supply line protection (EU)	Fuse slow max. 10 A	
		or	
		Circuit breaker max. 13 A	
		Characteristic B, C, D according to EN 60898	
		or	
		Power source with current limitation of max. 10 A	
	Power consumption	At "U" output signal	"I" output signal
	(QAM2161.040)	Max. <0.5 VA	Max. <1 VA
	(QAM3163.040)	Max. <0.5 VA	
	Power consumption (QAM2171.040, QAM3173.040)	<1 W	
Line lengths for measuring signal	Perm. cable lengths		
	Copper cable 0.6 mm dia.	50 m	
	Copper cable 1 mm ²	150 m	
	Copper cable 1.5 mm ²	300 m	

Functional data	Measuring range	–50...+ 50 °C (R2 = factory setting), 0...50 °C (R1), –35...+35 °C (R3)
	Probe	
	Probe length	0.4 m
	Minimum bending radius	10 mm
	Sensing element	Pt 1000
	Time constant	30 s at 2 m/s
	Dead time	< 1 s
	Measuring accuracy in the range of	
	23 °C (QAM3163.040, QAM3173.040)	±0.2 K
	–25...+ 25 °C	±0.75 K
	–50...+ 50 °C	±0.9 K
	Output signal, linear (terminal X1: QAM2161.040)	DC 0...5 V, DC 0...10 V $\hat{=}$ –50...+ 50 °C or –35...+35 °C or 0...50 °C, max. ± 1 mA 4...20 mA $\hat{=}$ –50...+ 50 °C or –35...+35 °C or 0...50 °C, max. 500 Ohm
	(terminal U1: QAM3163.040)	DC 0...10 V $\hat{=}$ –50...+ 50 °C or –35...+35 °C or 0...50 °C, max. ± 1 mA
	Output signal, linear (terminal I1: QAM2171.040, QAM3173.040)	4...20 mA $\hat{=}$ –50...+ 50 °C or –35...+35 °C or 0...50 °C
Degree of protection	Burden	refer to "Function"
	Protection degree of housing	
	QAM2161.040, QAM2171.040 QAM3163.040, QAM3173.040	IP54 according to EN 60529 IP65 according to EN 60529
Electrical connections	Protection class	III according to EN 60730-1
	Connection terminals for	1 x 2.5 mm ² or 2 x 1.5 mm ²
	Cable entry gland (enclosed)	M 16 x 1.5
Environmental conditions	Operation	IEC 721-3-3
	Climatic conditions	class 3K5
	Temperature (housing)	–40...+ 70 °C
	Humidity (housing)	5...95 % r. h.
	Transport	IEC 721-3-2
	Climatic conditions	class 2K3
Materials and colors	Temperature	–25...+ 70 °C
	Humidity	< 95 % r. h.
	Mechanical conditions	class 2M2
	Probe	copper, polyolefine
	Base	polycarbonate, RAL 7001 (silver-grey)
	Cover	polycarbonate, RAL 7035 (light-grey)
	Mounting flange	PA 66 (black)
Directives and Standards	Cable entry gland	PA, RAL 7035 (light-grey)
	Packaging	corrugated cardboard
	Product standard	EN 60730-1 Automatic electrical controls for household and similar use
	EU Conformity (CE)	CET1762xx *)
	RCM Conformity	CE1T1864en_C1 *)
	UL	UL 873, http://ul.com/database
	UKCA	A5W00188725A *)
	Environmental compatibility	The product environmental declaration CE1E1762*) contains data on environmentally compatible product design and assessments (RoHS compliance, materials composition, packaging, environmental benefit, disposal).
Weight	Incl. packaging	
	QAM2161.040	approx. 0.17 kg
	QAM3163.040	approx. 0.24 kg
	QAM2171.040	approx. 0.17 kg
	QAM3173.040	approx. 0.23 kg


*) The documents can be downloaded from <http://siemens.com/bt/download>.

Connection terminals


QAM2161.040



QAM3163.040




QAM2171.040, QAM3173.040




G, G0	Operating voltage AC 24 V (SELV) or DC 13.5...35 V
G1	Operating voltage DC 13.5...35 V
I1	Signal output 4...20 mA for measuring range -50...+50 °C (factory setting), 0...50 °C or -35...+35 °C
U1	Signal output DC 0...10 V for measuring range -50...+50 °C (factory setting), 0...50 °C or -35...+35 °C
X1	Signal output DC 0...5 V (QAM2161.040), DC 0...10 V, 4...20 mA for measuring range -50...+50 °C (factory setting), 0...50 °C or -35...+35 °C

Dimensions

QAM2161.040,
QAM2171.040

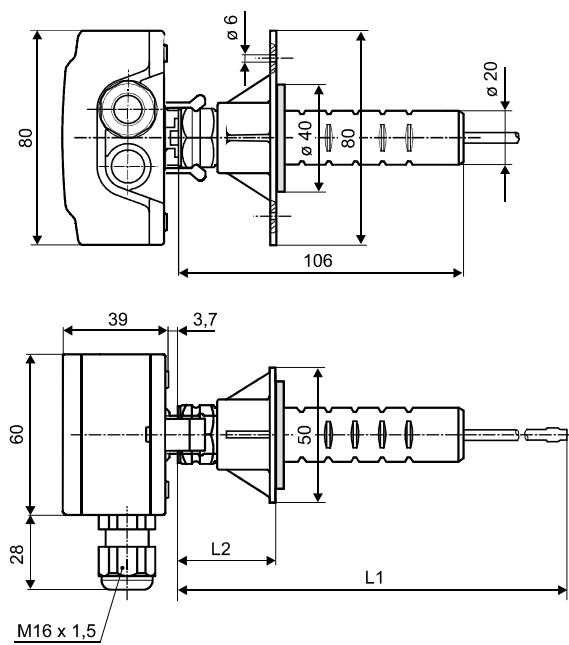


L1	L2	
	max.	min.
400	97	37

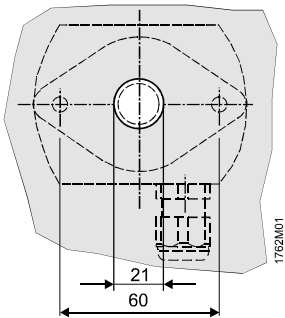


Drilling plan

QAM3163.040,
QAM3173.040

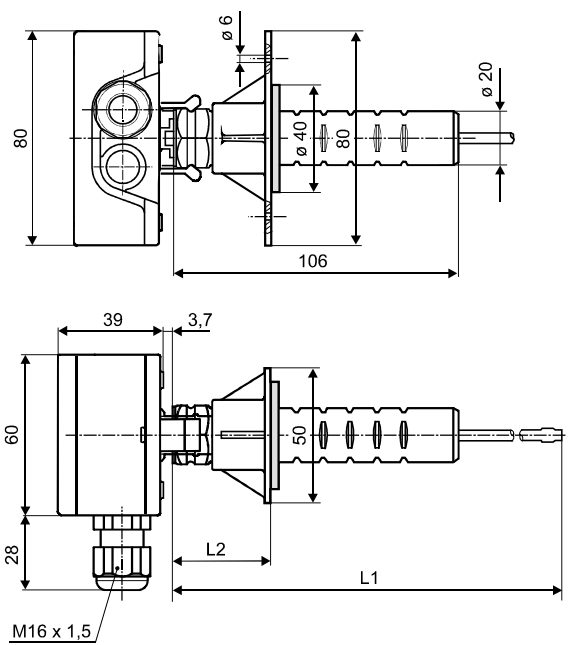

L1	L2	
	max.	min.
400	97	37

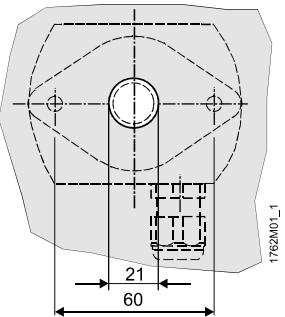

Drilling plan

Dimensions in mm

Issued by
Siemens Switzerland Ltd
Smart Infrastructure
Global Headquarters
Theilerstrasse 1a
CH-6300 Zug
Tel. +41 58 724 2424
www.siemens.com/buildingtechnologies

© Siemens 2004 – 2024
Technical specifications and availability subject to change without notice.